


PARAMETER LIST

FrigoPack FEP-12/
FrigoSoft 2.4

FS 2.4.2-1x

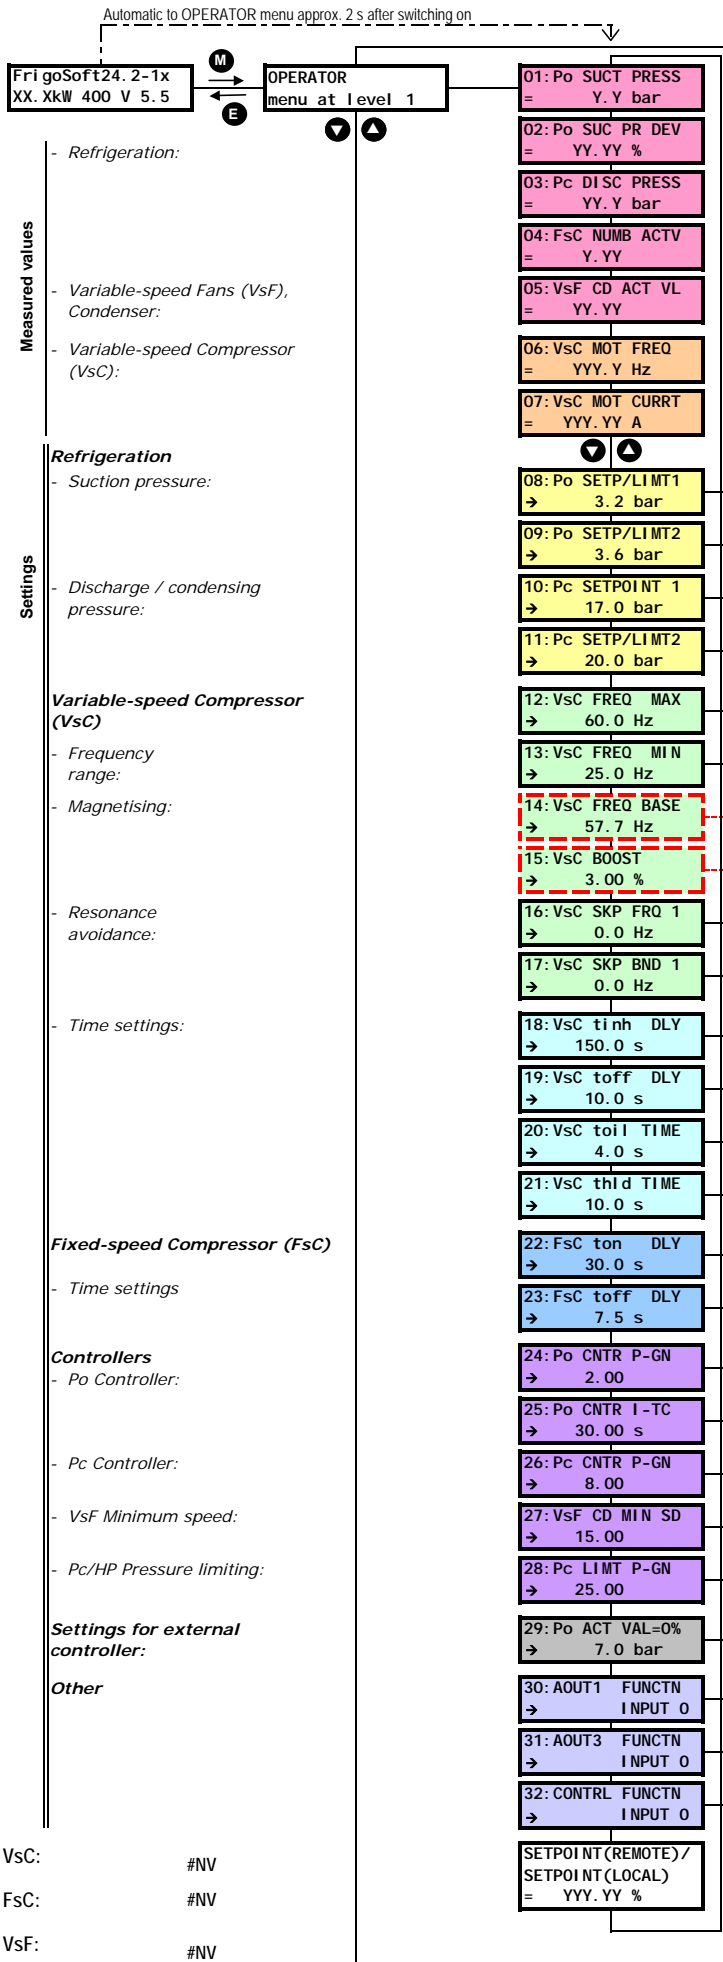

Type Value	Description	Further information
Measured value	Po, Suction pressure: -0.5 ... 7.0 bar	9.1
Deviation	Po, Suction pressure: -100.00 ... 100.00 %	
Measured value	Pc, Discharge / condens. pressure: 0.0 ... 25.0 bar	9.2
Measured value	Fixed-speed Compressors: Number active (in operation)	
Actuating value	Variable speed Fan, cond.: 0.00 ... 100.00 (%)	9.3
Measured value	Variable-speed Compressor: Motor Frequency	
Measured value	Variable-speed Compressor: Motor current	9.3
Set value 1	Po1, Setpoint / Limit: -0.5 ... 7.0 bar	
Set value 2	Po2, Setpoint / Limit: -0.5 ... 7.0 bar	8.3.2/3
Set value	Pc1, Setpoint: 0.0 ... 25.0 bar	8.3.4
Set value	Pc2, Setpoint / Limit: 0.0 ... 25.0 bar	8.3.5
Set value	VsC, Maximum frequency: 15.0 ... 90.0 Hz	8.4.1
Set value	VsC, Minimum frequency: 15.0 ... 90.0 Hz	8.4.2
Set value	VsC, Base frequency: 50.0 ... 90.0 Hz	
Set value	VsC, Boost: 0.00 ... 10.00 %	8.4.3
Set value	VsC, Skip frequency: 0.0 ... 90.0 Hz	
Set value	VsC, Skip frequency band: 0.0 ... 10.0 Hz	8.5.1
Set value	VsC, Inhibit delay: 0.1 ... 3000.0 s	
Set value	VsC, Switch-off delay: 0.1 ... 3000.0 s	
Set value	VsC, Oil lubrication pulse time: 0.1 ... 3000.0 s	
Set value	VsC, Hold time: 0.1 ... 3000.0 s	
Set value	FsC, Switch-on delay: 0.1 ... 3000.0 s	8.5.2
Set value	FsC, Switch-off delay: 0.1 ... 3000.0 s	
Set value	Po controller, Proportional gain: 0.1 ... 100.0	8.6.1
Set value	Po controller, Integr. time const.: 0.0 ... 100.0 s	
Set value	Pc controller, Proportional gain: 0.00 ... 100.00	8.6.2
Set value	Var.-speed Fan, cond., min. speed: 0.00 ... 100.00	
Set value	Pc limiter, Proportional gain: 0.00 ... 100.00	8.7
Set value	Po at actuating value = 0 %: -0.5 ... 7.0 bar	
Set value	AOUT1 - Function selection: INPUT 0..2	8.9.1
Set value	AOUT3 - Function selection: INPUT 0..2	8.9.2
Set value	FrigoSoft - Function selection: INPUT 0..7	8.9.3
Measured value	Activating value of speed	9.2

VsC: #NV
Fsc: #NV
VsF: #NV